



Long Rod Insulators

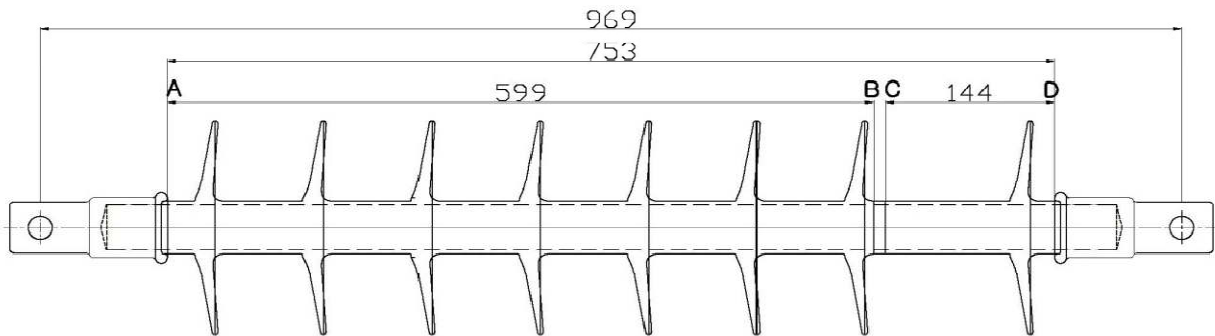

The following Long Rod insulators(Polymer Type T-m, Polymer Type N-a) comply with the Korean Railway Standards.

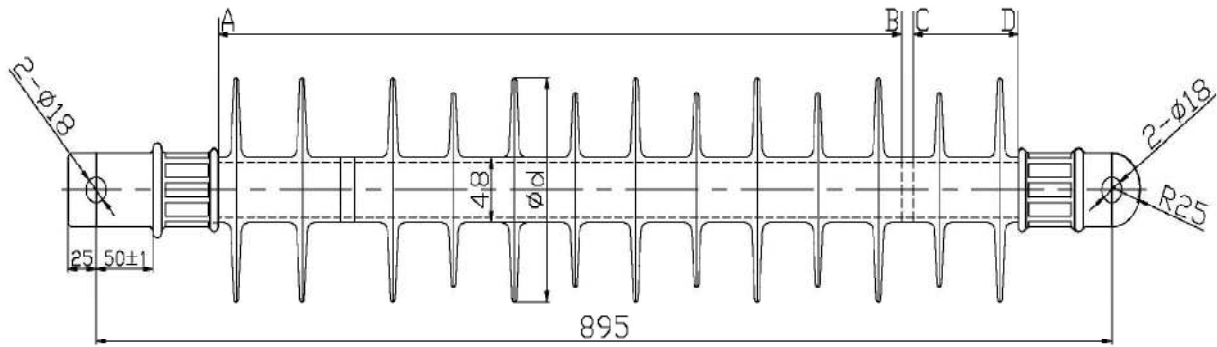

Standard Specification : Korean Railway Standards

Discription		PW 0015-08(R)	PW 0014-07(R)
Creepage Distance	mm	A-B : 1400	A-B : 1250
Bending Fracture Strength	N	1,863	3,430
Tensile strength(1min)	N	54,917	58,840
Power voltage flashover voltage	Dry	kV	A-B : 250
	Wet	kV	A-B : 200
50% Impulse flashover voltage		kV	A-B : 400
			C-D : 110
Radio Influence Voltage Data	Test Voltage to Ground	kV	25
	Max. RIV at 1000KHz	µV	10



WOOJIN Electric & Power Co., LTD.